


Inside Tank

Outside Tank

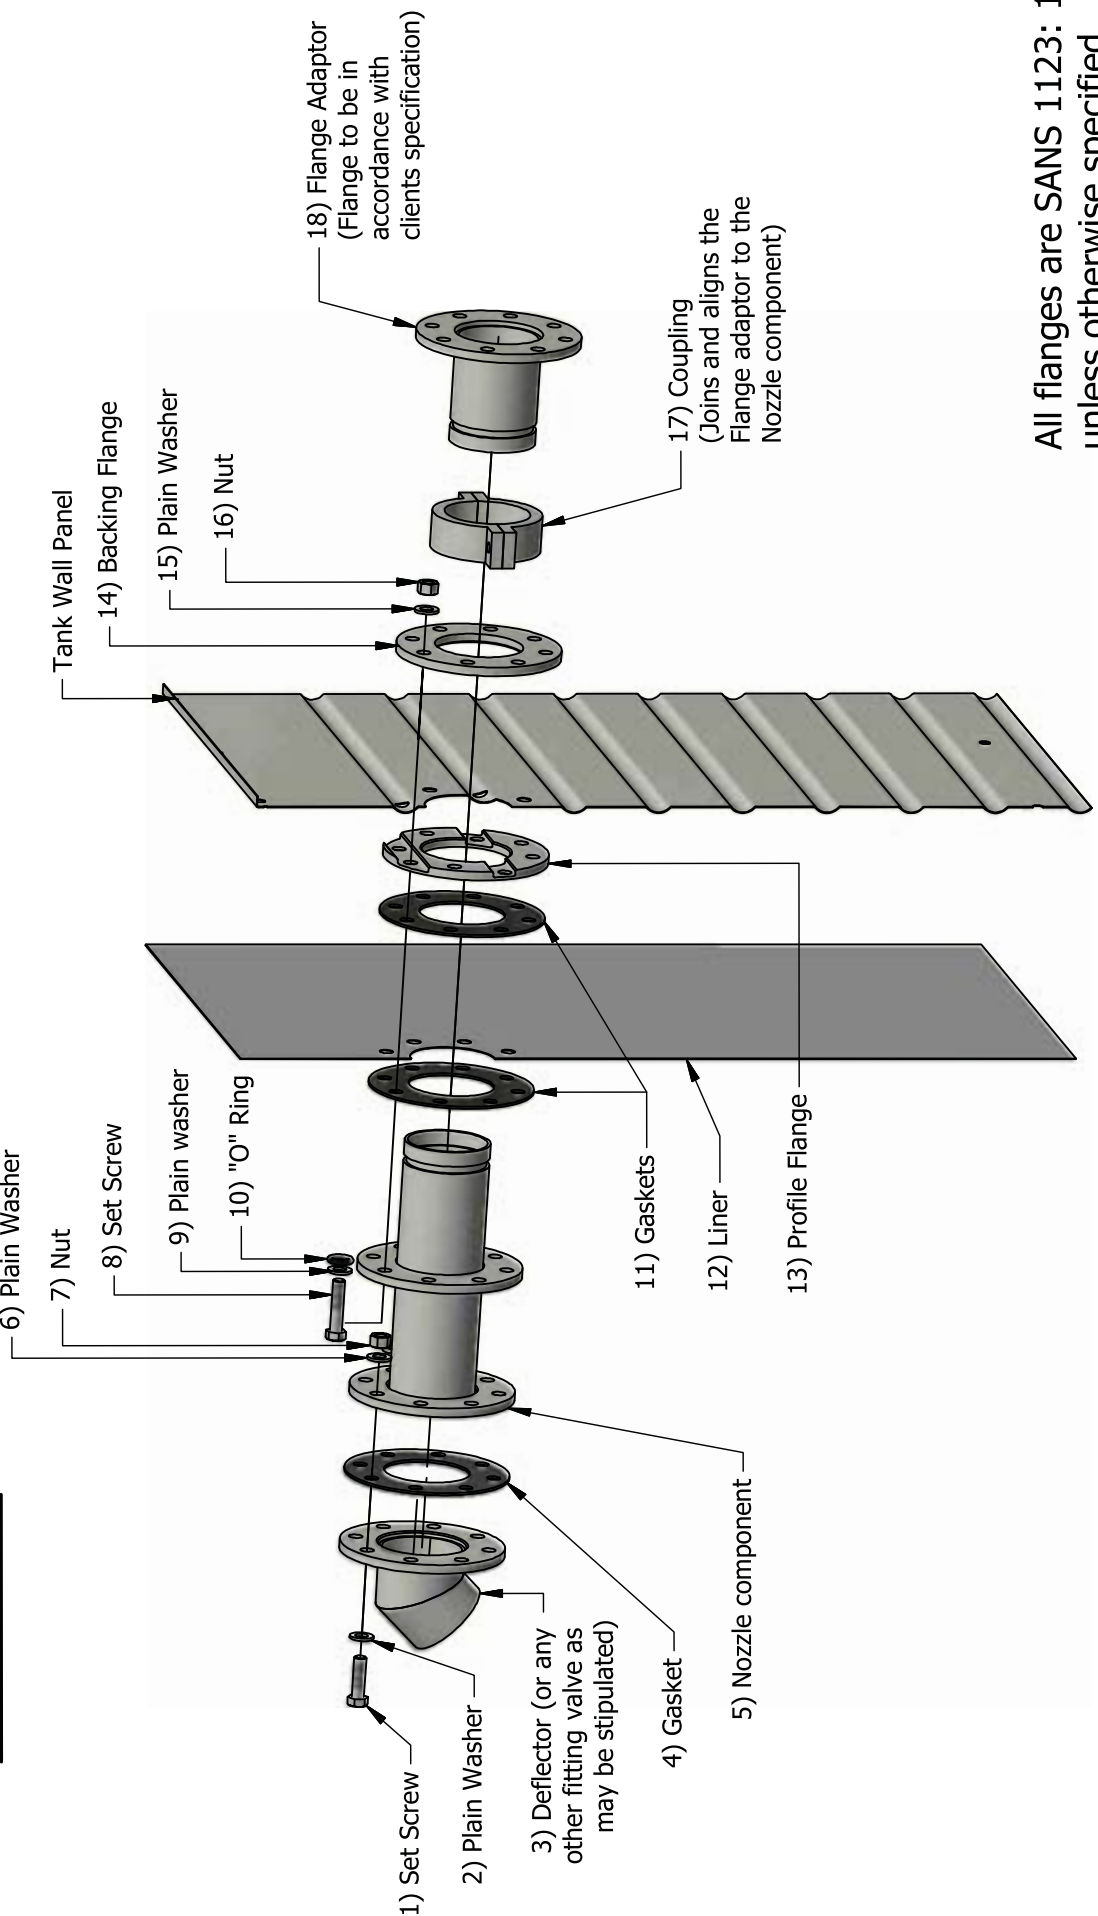

All flanges are SANS 1123: 1000\3 unless otherwise specified

Rev.	By	Date	Revisions	Approved	Drawn:	BEW	Title:	
5							Typical Nozzle Installation	
4								
3								
2	BEW	2014 07 16	Liner representation added.	CRL				
1	BEW	2014 02 18	Fasteners added	BMCP				
Dwg No:	Typical Nozzle Installation_R02						Rev:	02
Description:	Standard						Sheet:	1 \ 1



Unit 6 Surprise Park, 11 Surprise Rd, Maxmood, 3610, Kwa-Zulu Natal, South Africa
 Tel: +27 (0)31 716 1820 Fax: +27 (0)31 716 1821
 e-mail: info@sbtanks.co.za
 www.sbtanks.co.za

The information contained herein is property of SBS Water Systems (Pty) Ltd and is covered by patent and copyright. This drawing is confidential and its contents may not be copied, reproduced or used for any purpose without the prior written permission of SBS Water Systems (Pty) Ltd.